

SEPTIC TANK 10,000 GALLON

NOTES:


CONCRETE: 5000 psi @28 days
REF.: to conform with 5000 gallon tank
and specified earth cover


OPENINGS: 6" coreouts

DIVIDER BAFFLE: concrete partition w/ 6" x 48"
traverse slot located 2/3rds the
height of water level

CONTRACTOR TO SUPPLY & INSTALL:

4" PVC SDR 35 Vent Line
8" PVC SDR 35 Equalization Line
6" PVC SDR 35 Inlet/Outlet Baffles

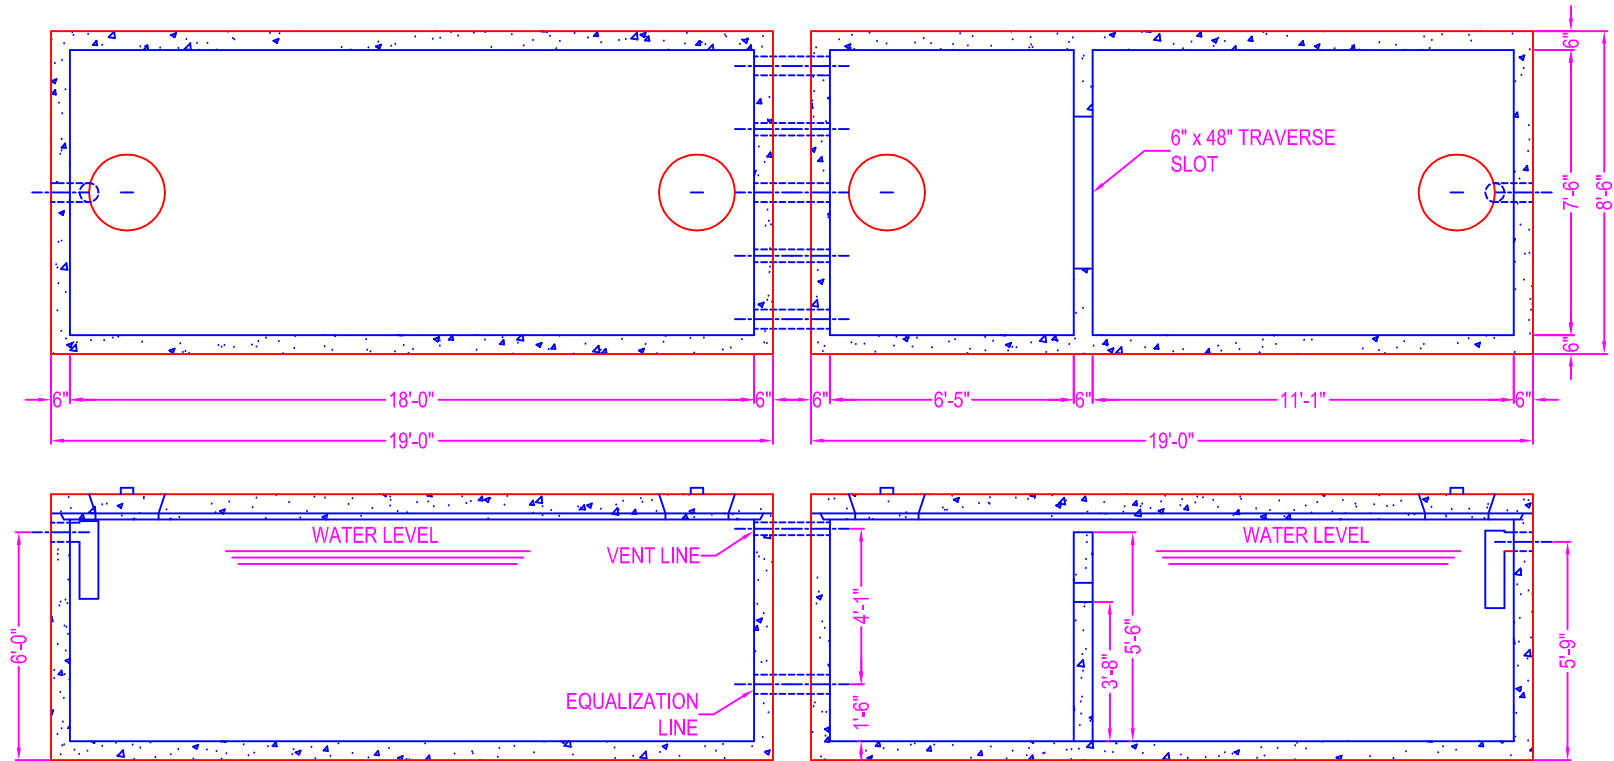

 <p>Zeiser Wilbert VAULT, INC. CONCRETE PRODUCTS</p>	<p>750 Howard Street Elmira, NY 14904 Fax: (607) 737-0291 Phone: (607) 733-0568 1-800-472-4335</p>	<p>Title: ST 10,000 GALLON</p>	<p>Drawn By: JPS</p>
		<p>Scale: Not To Scale</p>	<p>Drawing No.: 1019</p>
		<p>Date: 10-5-99</p>	