
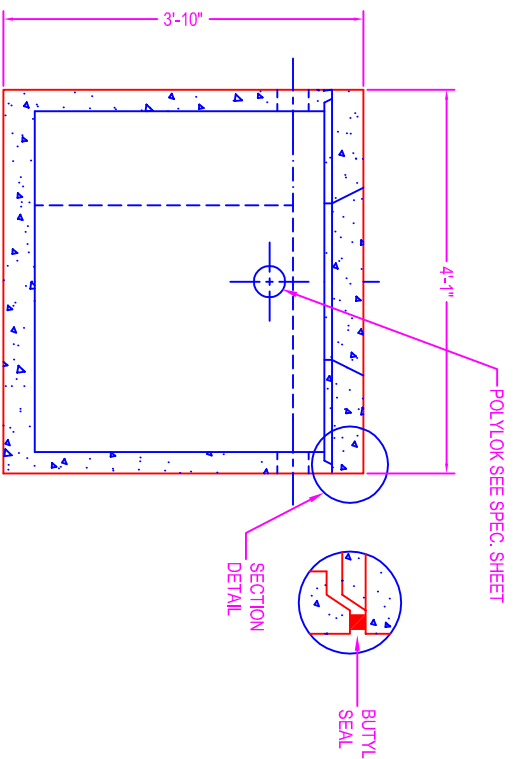


# CHLORINE DISPENSING TANK

- 3-Inlets
- 1-Outlet

**NOTES:**

CAPACITY: 500 Gallons  
 CONCRETE: 5000 psi @ 28 days  
 POLYPROPYLENE FIBERS  
 REF.: #3 rebar  
 PIPE CONNECTS: Polylok

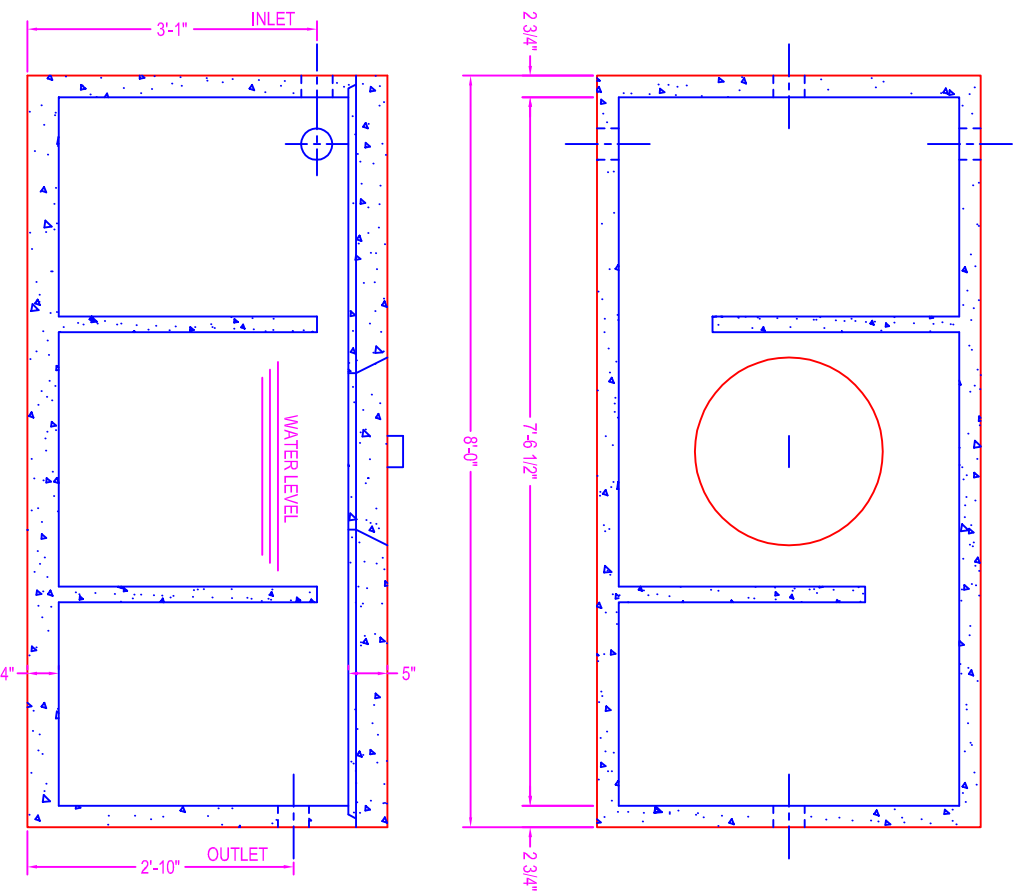

**Zeiser**  
**Wilbert**  
 VAULT, INC.  
 CONCRETE PRODUCTS

750 Howard Street Elmira, NY 14904  
 Fax: (607) 737-0291  
 Phone: (607) 733-0568  
 1-800-472-4335

**Title: CHLORINE DISP. TANK**

Drawn By: JPS  
 Drawing No.: 1075  
 Date: 1-6-00

Scale: Not To Scale