


ELECTRIC VAULT COVERS

NOTES:

CONCRETE: 5000 psi @ 28 days
 REF: #4 rebar @ 6" o.c. each way
 1/2" Chamfer strip around all top edges
 including opening

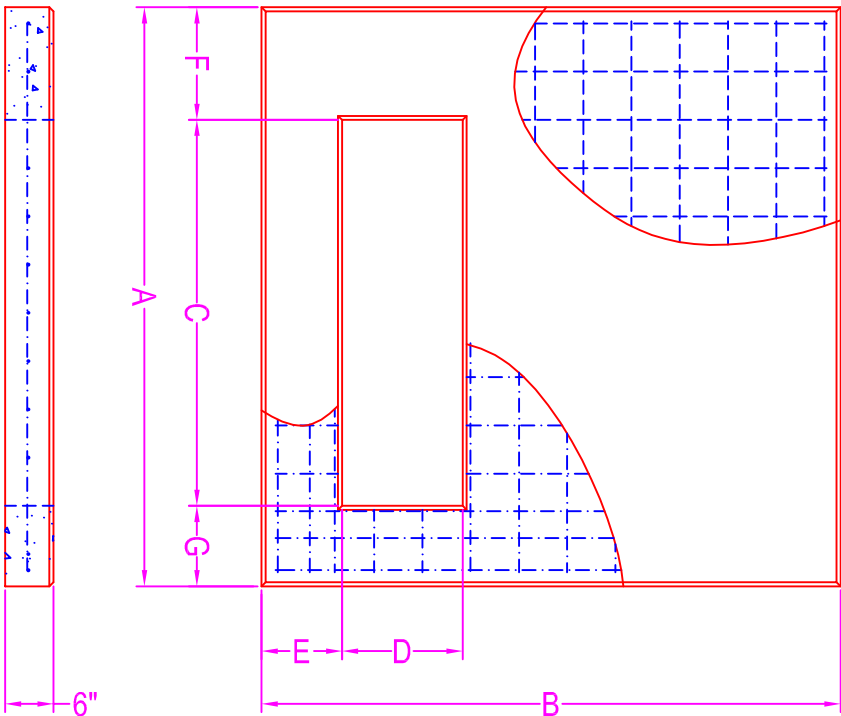

TYPE	KVA	A	B	C	D	E	F	G	SS#
Ull.	25-167*	50	50	24	12	7	13	13	262-803-00
Ull.	75-500	72	72	40	16	12	16	16	262-776-00
Ull.	750-2500	89	75	50	17	14	21	18	262-781-00
Ull.	75-1500	89	75	50	17	14	21	18	262-781-00
Ull.	2500	96	96	60	24	12	24	12	262-782-00
Step	250-500	76	71	30	15	22.5	23	23	262-790-00
Step	500-1500	95	89	43	17	20	26	26	262-791-00
Step	1500-2500	96	96	62	17	20	17	17	262-792-00
Step	3750-5000	120	120	80	24	20	20	20	262-793-00

* Used for conversion of a submersible transformer installation to a padmount installation. This unit is 4" thick not 6"

Zeiser
Wilbert
 VAULT INC.
 CONCRETE PRODUCTS

750 Howard Street Elmira, NY 14904
 Fax: (607) 737-0291
 Phone: (607) 733-0568
 1-800-472-4335

Title: Electric Vault Covers

Drawn By: JPS
 Drawing No.: 07100700
 Date: 7-10-07

Scale: Not To Scale