

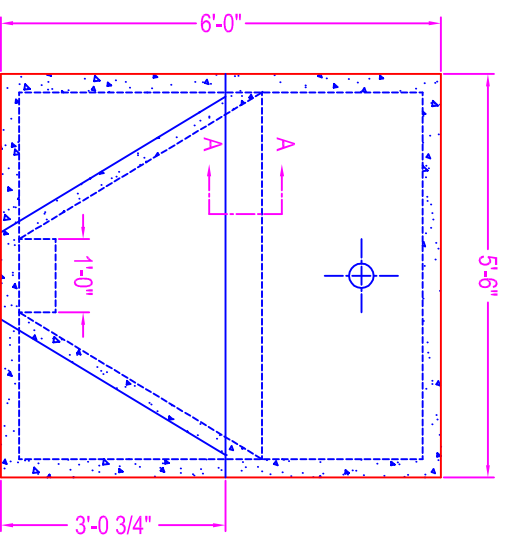
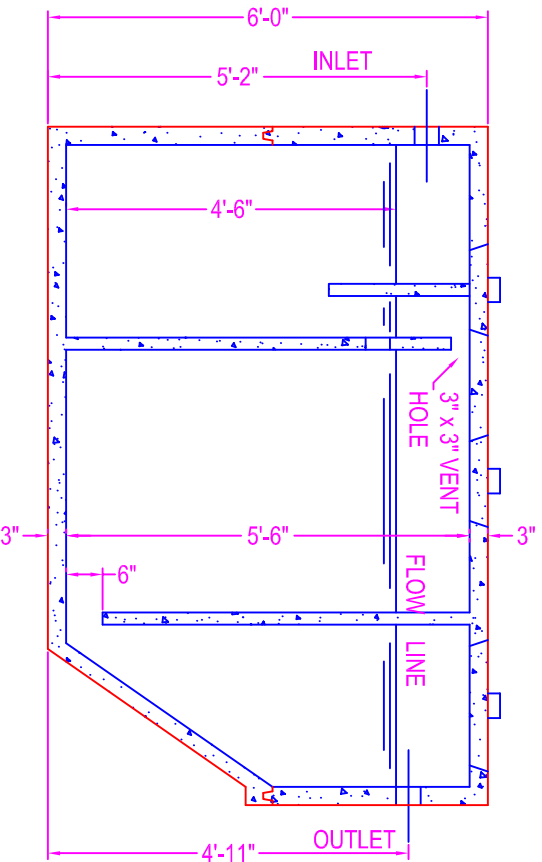


# OIL SEPARATOR OT - 1200

**NOTES:**

- CONCRETE: 5000 psi @ 28 days
- REF.: #3 rebar around seams (single bar)
- #3 rebar @ 12" o.c. each way top & bottom
- POLYPROPYLENE FIBERS
- INLET/OUTLET: Polylok

Contractor has the option of using chimneys to bring the tank to grade or using cast iron frame & covers to replace the concrete wedge plugs.

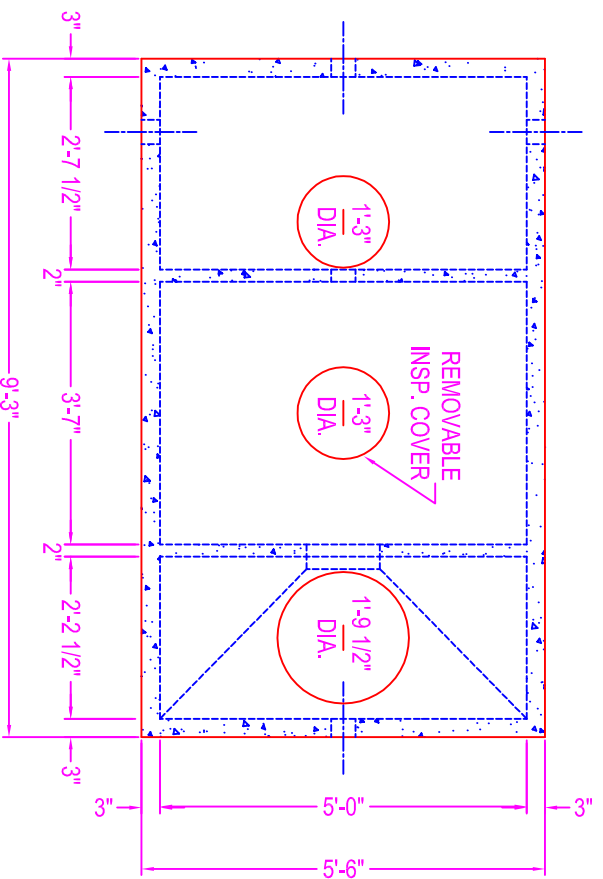

**Zeiser**  
**Wilbert**  
VAULT, INC.  
CONCRETE PRODUCTS

750 Howard Street Elmira, NY 14904  
Fax: (607) 737-0291  
Phone: (607) 733-0568  
1-800-472-4335

**Title: OT-1200**  
**Scale: Not To Scale**

Drawn By: JPS  
Drawing No.: 1040  
Date: 12-21-99