

SEPTIC TANK 10,000 GALLON

NOTES:

CONCRETE: 5000 psi @28 days
REF.: to conform with 5000 gallon tank
and specified earth cover

OPENINGS: 6" corecuts


DIVIDER BAFFLE: concrete partition w/ 6" x 48"
traverse slot located 2/3rds the
height of water level

CONTRACTOR TO SUPPLY & INSTALL:

4" PVC SDR 35 Vent Line

8" PVC SDR 35 Equalization Line

6" PVC SDR 35 Inlet/Outlet Baffles

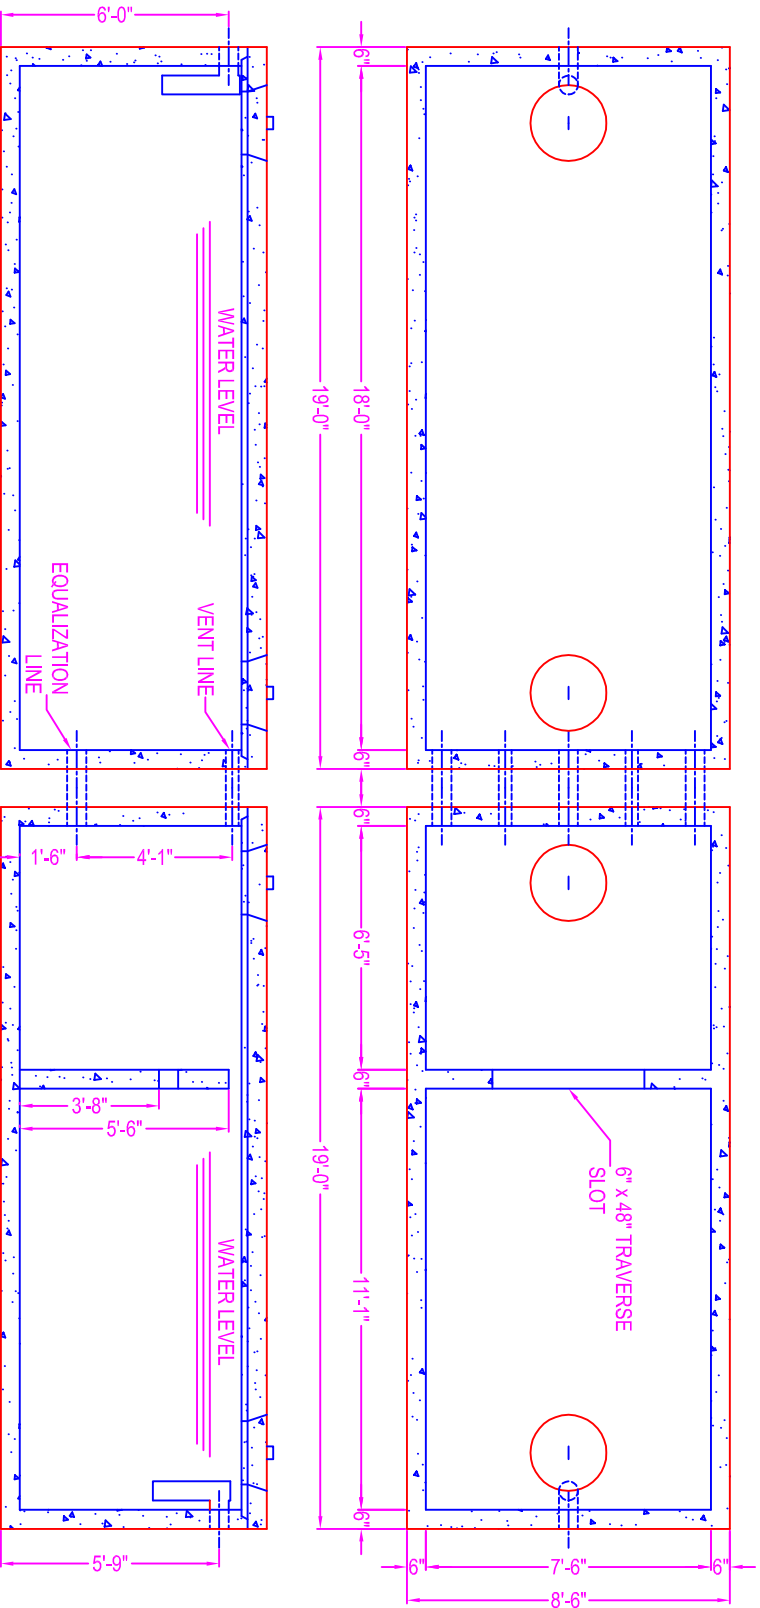

**Zeiser
Wilbert
VAULT, INC.**
750 Howard Street Elmira, NY 14904
Fax: (607) 737-0291
Phone: (607) 733-0568
1-800-472-4335

Title: ST 10,000 GALLON
Scale: Not To Scale

Drawn By: JPS
Drawing No.: 1019
Date: 10-5-99