


# SEPTIC TANK 15,000 GALLON

**NOTES:**

CONCRETE: 5000 psi @28 days  
 REF.: to conform with 5000 gallon tank  
 and specified earth cover  
 OPENINGS: 6" coreouts  
 DIVIDER BAFFLE: outlet endwall of 2nd tank  
 Third Tank to be set 3" lower  
 to allow for full 5000 gallon capacity

**CONTRACTOR TO SUPPLY & INSTALL:**

4" PVC SDR 35 Vent Line  
 8" PVC SDR 35 Equalization Line  
 6" PVC SDR 35 Inlet/Outlet Baffles

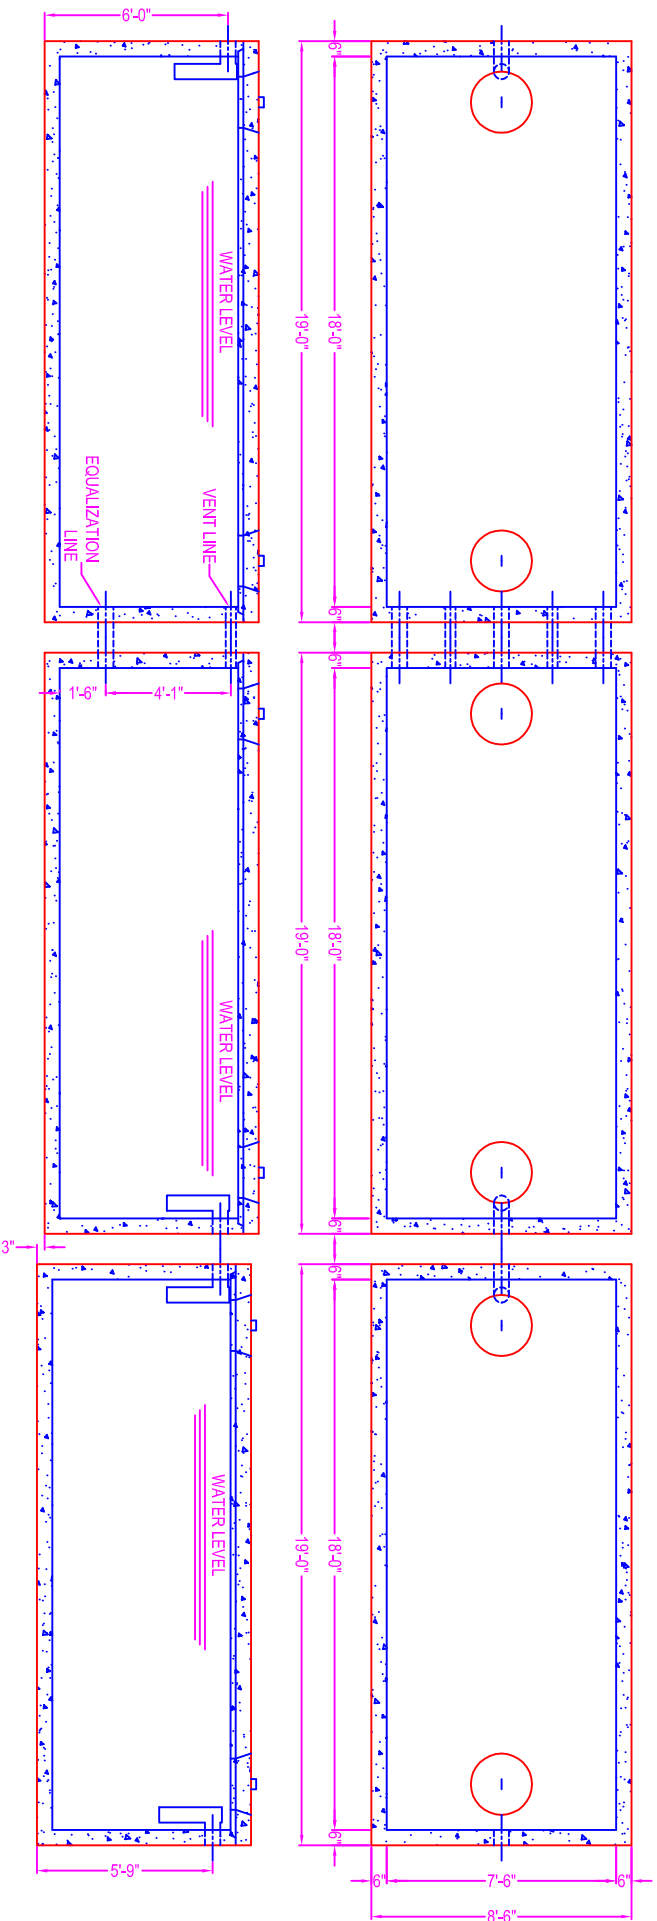

**Zeiser**  
**Wilbert**  
 VAULT, INC.  
 CONCRETE PRODUCTS

750 Howard Street Elmira, NY 14904  
 Fax: (607) 737-0291  
 Phone: (607) 733-0568  
 1-800-472-4335

**Title: ST 15,000 SEP TANK**

Drawn By: JPS  
 Drawing No.: 1020  
 Date: 10-19-99

Scale: Not To Scale